



5140MPS-1 / 5140MPS-2 Manual Pull Stations

PRIMARY FEATURES

- ADA COMPLIANT
- KEY TEST OR ALLEN RESET
- KEYED TO ADEMCO CONTROLS
- STYLIZED HIGH TECH DESIGN
- ALUMINUM DIE CAST HOUSING
- TERMINAL BLOCK OR WIRE LEADS
- GOLD CONTACTS
- UL LISTED

■ GENERAL DESCRIPTION

Ademco's manual fire alarm stations are designed to be non-code single action devices for use in UL listed fire alarm applications. The attractive die-cast aluminum-alloy housing meets ADA pull requirements and has been tested at Underwriter's Laboratory.

For ADA compliance, manual stations must be mounted less than 48" above the floor for front wheelchair access and less than 54" above the floor for side wheelchair access.

A key reset feature on the 5140MPS-1 is designed for positive authorized resetting action. The key is designed to operate and match Ademco controls. The 5140MPS-1 utilizes a terminal block for secure terminations. The 5140MPS-2 is furnished with an Allen hex fitting and is equipped with wire leads.


Two alarm deterrent break tubes are supplied with each manual station; one tube is visible from the front, and the spare is stored in a compartment within the unit.

■ OPERATION

Pulling the handle down causes the manual stations to latch in the down position and to close the normally open switch. The handle is restored manually by using the key to unlock the station and pivot the station forward for resetting the pull handle to its normal position. The crush tube is then inserted in the cavity and the station assembly is then locked in the normal upright position.

■ CONSTRUCTION

The 5140MPS-1 and 5140MPS-2 manual stations are constructed of a durable die-cast aluminum-alloy and

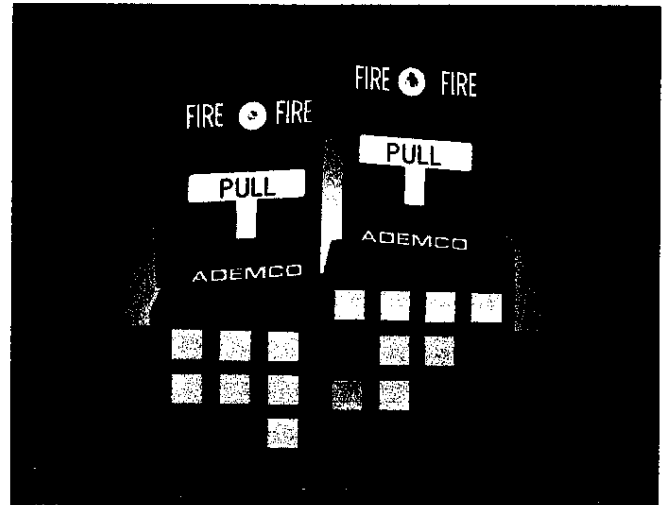

provide a neat and distinctive appearance. The housing is finished in red with white raised lettering and the "T-bar" handle is white with raised red lettering for enhanced visibility. The units are adaptable to both surface and semi-flush mounting configurations.

■ MOUNTING

SEMI-FLUSH MOUNT

Most semi-flush mount installations can be attached to a standard single-gang switch box using two 6-32 screws inserted through the slots that are centered on the unit's metal mounting plate.

SURFACE MOUNT

Use Ademco Backbox model number 5140MPS-BB for surface mount installations. The Backbox has four pre-drilled mounting holes of 0.187 inch diameter and conduit knockouts. Secure the Backbox to a wall with screws of size 8 or smaller. After the Backbox is in place, attach the conduit.

The housing is locked by using a key or Allen wrench lock. Unlock the housing by turning the key clockwise and swinging down the front of the housing to make the sheet metal mounting plate accessible. Mount the metal plate to the Backbox using the four 1/4" long, 8-32 screws (supplied).

■ DIMENSIONS

4.75" H x 3.12" W x 2" D

ADEMCO

The Technology Leader


■ ORDERING INFORMATION

5140MPS-1: Manual Station
Key Reset Test
and Terminal Block

5140MPS-2: Manual Station
Hex Allen Reset
Test and Wire Leads

5140MPS-BB: Surface Backbox

■ WIRING DIAGRAM

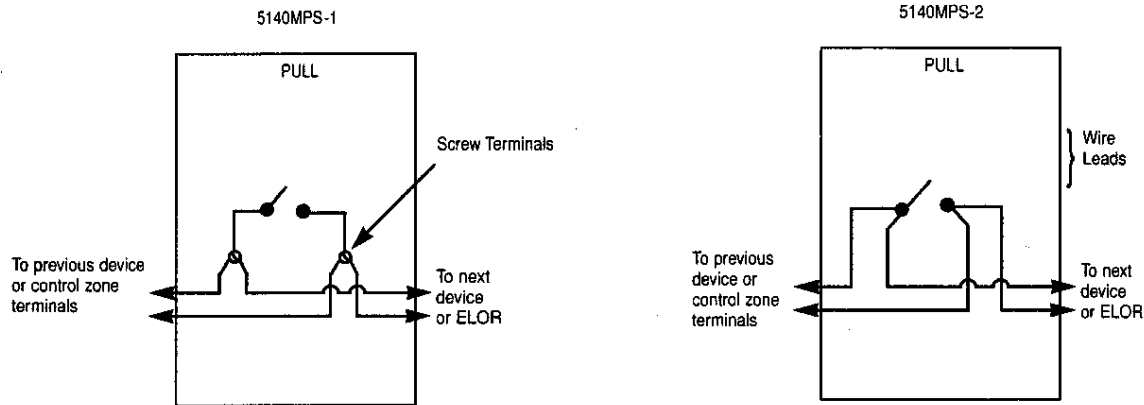

ARCHITECTURAL/ENGINEERING SPECIFICATIONS

Manual Fire Alarm Station Model 5140MPS-1 (5140MPS-2) shall be non-coded and include a break-type tube operated test-reset lock allowing testing with a key (Allen wrench). They shall be designed so that normal operation cannot be restored after an actual Fire Emergency Operation except by use of a key (Allen wrench). The key shall fit all standard Ademco controls.

An operated station shall automatically condition itself so as to be visually detected, as operated, at a mini-

mum distance of one hundred feet, front or side. Manual Stations shall be constructed of die cast aluminum alloy with clearly visible operating instructions provided on the cover. The word FIRE shall appear on the front of the stations in raised letters. Stations shall be suitable for surface mounting on matching Backbox, or semi-flush mounting on a standard single-gang box. Manual Stations shall be Underwriter's Laboratories Listed.

ADEMCO

The Technology Leader