Smart App Sinewave Series PR1000LCDRT2U/PR1000LCDRTXL2U PR1500LCDRT2U/PR2200LCDRT2U

User's Manual

IMPORTANT SAFETY WARNINGS

This manual contains important instructions that should be followed during installation and maintenance of the UPS and batteries. Please read and follow all instructions carefully during installation and operation of the unit. Read this manual thoroughly before attempting to unpack, install.

CAUTION! The UPS must be connected to a grounded AC power outlet with fuse or circuit breaker protection. DO NOT plug the UPS into an outlet that is not grounded. If you need to power-drain this equipment, turn off and unplug the unit.

CAUTION! DO NOT USE FOR MEDICAL OR LIFE SUPPORT EQUIPMENT! Under no circumstances this unit should be used for medical applications involving life support equipment and/or patient care.

CAUTION! The battery can power hazardous components inside the unit, even when the AC input power is disconnected

CAUTION! The UPS should be near the connected equipment and easily accessible.

CAUTION! To prevent the risk of fire or electric shock, install in a temperature and humidity controlled indoor area, free of conductive contaminants. (Please see specifications for acceptable temperature and humidity range).

CAUTION! To reduce the risk of an electric shock, do not remove the cover, except to service the battery. There are no user serviceable parts inside, except for the battery. CAUTION! To avoid electrical shock, turn off the unit and unplug it from the AC power source before servicing the battery or installing a

CAUTION! DO NOT USE WITH OR NEAR AQUARIUMS! To reduce the risk of fire, do not use with or near aquariums. Condensation from

the aquarium can come in contact with metal electrical contacts and cause the machine to short out.

CAUTION! DO NOT USE WITH LASER PRINTERS! The power demands of laser printers are too large for a UPS.

INSTALLING YOUR UPS SYSTEM

UNPACKING

Inspect the UPS upon receipt. The box should contain the following.

(1) UPS Unit; (1) User's Manual for UPS; (2) Rack mount Brackets; (2) Stands; (2) Skids; (1) Telephone Cable (black); (1) Emergency Power Off Cable (gray); (1) PowerPanel® Business Edition Software CD; (2) Serial Interface Cable (DB-9); (1) USB A+B type cable; (1) Warranty Registration Card

OVERVIEW

The PR1000LCDRT2U/PR1000LCDRTXL2U/PR1500LCDRT2U/PR2200LCDRT2U provides automatic voltage regulation for inconsistent utility power. The PR1000LCDRTXL2U features 2060 Joules, and PR1000LCDRT2U / PR1500LCDRT2U/PR2200LCDRT2U features 1874 Joules of surge protection, and provides battery backup during power outages. The PR1000LCDRT2U/PR1000LCDRTXL2U/

PR1500LCDRT2U/PR2200LCDRT2U ensures consistent power to your computer system and its included software will automatically save your open files and shutdown your computer system during a utility power

What is AVR?


K01-0000057-06



AUTOMATIC VOLTAGE REGULATOR(AVR)

The PR1000LCDRT2U/PR1000LCDRTXL2U/PR1500LCDRT2U/PR2200LCDRT2U can stabiliz the consistent utility power. The utility power may be damaging to important data and hardware, but Automatic Voltage Regulation helps the computer not experience dangerous voltage levels. Automatic Voltage Regulator automatically regulates low or high voltages to keep equipment working at safe AC power levels (110/120V) without switching to battery. Your equipment can operate normally even meet the power problems, such as, shout brownouts and blackouts. The unit's powerful sealed lead-acid batteries will provide power only if the incoming voltage drops below 80V or increases above 150V.

SYSTEM BLOCK DIAGRAM

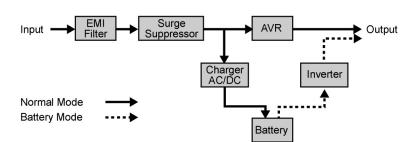

HARDWARE INSTALLATION GUIDE

1. Battery charge loss may occur during shipping and storage. For the first time the UPS is used, it's strongly recommended to charge batteries for at least eight hours is recommended to ensure that the batteries' maximum charge capacity. To recharge the batteries, simply make the UPS plugs into an AC outlet.

2. When you use the included software, connect either the serial or the USB cable between the computer and the corresponding port on the UPS. Note: If the USB port is used, the serial port will be disabled. They cannot be used simultaneously. The computer with the PowerPanel® Business Edition S/W connects to the USB port or the Serial port on the UPS. It can control the operating schedule, battery test, outlet, etc. and get information on the UPS status. However, other computers with PowerPanel® Business Edition S/W can only get UPS status information via a LAN connection.

3. With the UPS off and unplugged, connect your computer, monitor, and any externally powered data storage device (Hard drive, Tape drive, etc.) into the outlets. DO NOT plug a laser printer, copier, space heater, vacuum, paper shredder or other large electrical device into the UPS. The power demands of these devices will overload

4. To protect a fax, telephone, modern line or network cable, connect the telephone or network cable from the wall jack outlet to the jack marked "IN" of the UPS. Then, connect a telephone cable or network cable from the jack marked "OUT" on the UPS to the modem, computer, telephone, fax machine, or network device.

5. Plug the UPS into a 2 pole, 3 wire grounded receptacle (wall outlet). Make sure the wall branch outlet is protected by a fuse or circuit breaker and does not service equipment with large electrical demands (e.g. air conditioner, refrigerator, copier, etc.). Avoid using extension cords

6. Press the power switch to turn the UPS on. The Power-On indicator light will illuminate. If an overload is detected, an audible alarm will sound and the UPS will emit one long beep. In order to reset it, turn the unit off and unplud some equipment from outlets. Make sure your equipment carry a load current within the unit's safe range, (refer to the technical specifications), and then turn the unit on.

7. Your UPS is equipped with an auto-charge feature. When the UPS is plugged into an AC outlet, the battery will be automatically charging, even when the unit is switched off!


8. To always maintain an optimal battery charge, leave the UPS plugged into an AC outlet at all times

9. Before storing the LIPS for an extended period of time, turn the unit OFF. Then cover it and store it with the batteries fully charged. Recharge the batteries every three months or so, to ensure good battery capacity and long battery life; further, this might also prevent damage to the unit from an unlikely battery leakage.

10. The unit provides one Primary Serial Port (I), Secondary Serial Port (II), and one USB port, (paired with the Primary Serial Port), to allow connection and communication between the unit and any attached computers. The Primary Serial Port (I) as well as its paired USB port allow for bi-directional communication among the UPS and the primary connected computer running the PowerPanel® Business Edition S/W provided. The UPS can control the computer's shutdown in case of an emergency, and at the same time, the computer can monitor the UPS and alter its various programmable parameters. On the other hand, secondary Serial Port II only allows the UPS to initiate the connected computer's graceful auto-shutdown in case of an emergency

11. EPO (Emergency Power Off) Port:

Use the provided gray cable to connect to a special EPO contact switch. Follow the appropriate circuit diagram below to wire the cable to your EPO configuration. The EPO remote switch is a switch installed in an outside area. connected to the unit via an ordinary RJ-11 phone line. In case of an emergency, it can be used to immediately



00

When you first receive the


unit, plug in the unit to fully

Unplug the unit and turn Power

Off when first connecting your

computer and peripherals.

•



Dry connect is controlled by the PowerPanel® Software, please *NOTE: Both USB and Serial cannot be used simultaneously

The primary computer with PowerPanel® Business Edition software connected to the UPS with either a serial cable or a USB cable

The equipment can via dry contact.

BASIC OPERATION

FRONT / REAR PANEL DESCRIPTION

Master on/off switch for equipment connected to the UPS.

2. Power On Indicator

Indicates that the AC utility input power's condition is normal and that the UPS outlets are providing power, free of surges and spikes. 3. LCD Module Display

4. LCD Display Toggle Button

Used to select among a variety of information the LCD can display. 5. Battery Backup Protected Outlets

The unit provides a total of eight outlets with battery backup and surge protection. They ensure that connected equipment will keep an uninterrupted operation over a period of time, during a power

Critical /Non-critical

It is possible to program the unit in a way so that the outlet block marked as "non-Critical", (4 ports), will stop the provision of power to connected equipment after a certain period of time, thus making more runtime available for the equipment connected on the outlets marked as "Critical", (4 ports). In other words, the user can establish runtime priority for certain connected equipment, maximizing its "availability" during a prolonged power outage. This type of control takes place with the use of the provided PowerPanel® Business Edition S/W.

Connect the AC Power cord to a properly wired and grounded outlet.

7. Output Circuit Breaker

This circuit breaker serves to provide output overload and fault protection.

This circuit breaker serves to provide input overload and fault

9. USB port.

This is a connectivity port allowing communication and control among the UPS and the connected computer. You should install on your computer the PowerPanel® Business Edition S/W appropriate to the operating system you are using.

10. Protected Communication Ports RJ11/RJ45

Ports protect standard single line modem, fax, telephone line or network cable.

11. Site Wire Fault Indicator

This LED will illuminate to warn the user that a wiring problem exists within the AC receptacle, such as a bad ground or reversed wiring. If illuminated, disconnect all equipment and contact an electrician to ensure outlet is properly wired.

12. Coax/Cable/DSS Surge Protection

The Coax/Cable/DSS surge protection ports will protect any cable Modem, CATV converter or DSS receiver.

13. Serial Port I

Serial port allows connection and communication between the UPS and the computer.

14. Serial Port II

Serial Port II relays information to equipment that can utilize a contact

closure UPS

15. SNMP/HTTP Network slot Remove the cover panel to install optional SNMP that allows remote

monitoring and control of your UPS on a network.

16. EPO (Emergency Power Off) Port: Allow for an emergency UPS Power-Off from a remote location.

BATTERY REPLACEMENT

Contact your dealer or call the number in this manual for information on battery replacement. The part numbers of internal battery are RBP832 for PR1000LCDRT2U/PR1000LCDRTXL2U/PR1500LCDRT2U, RBP842 for PR2200LCDRT2U. For external battery pack of PR1000LCDRTX2U. the part number is BP48V45ART2U.

Read and follow the IMPORTANT SAFETY INSTRUCTIONS before servicing the battery. Service the battery under the supervision of personnel knowledgeable of batteries and their precautions. Servicing the battery can only be performed by trained personnel. Replacement of batteries located in an OPERATOR ACCESS AREA.

CAUTION! When replacing batteries, replace with the same number of the following battery: BP7-12(BB) for PR1000LCDRT2U/ PR1500LCDRT2U/ PR1000LCDRTXL2U, HR9-12(BB) for PR2200LCDRT2U

CAUTION! Risk of Energy Hazard, 12 V, maximum 7 Ampere-hour(BP7-12) or 9 Ampere-hour battery(HR9-12). Before replacing batteries, remove conductive jewelry such as chains, wrist watches, and rings. High energy through conductive materials could cause severe burns.

CAUTION! Risk of battery explosion, if battery is replaced by an incorrect type. Dispose of used battery according to the instructions CAUTION! To reduce the risk of fire, connect only to a circuit provided with 20 amperes maximum branch circuit overcurrent protection in accordance with the National Electric Code, ANSI/NFPA 70.

CAUTION! For model PR1000LCDRTXL2U can be provided with a maximum of four extension battery packs.

CAUTION! Use only the specified type of battery. See your dealer for replacement batteries.

CAUTION! The battery may present the risk of electrical shock. Do not dispose of batteries in a fire, as they may explode. Follow all local ordinances regarding proper disposal of batteries.

CAUTION! Do not open or mutilate the batteries. Release electrolyte is harmful to the skin and eyes and may be toxic.

CAUTION! A battery can present a high risk of short circuit current and electrical shock.

Take the following precautions before replacing the battery:


- 1. Remove all watches, rings or other metal objects.
- 2. Only use tools with insulated handles. 3. Do not lay tools or metal parts on top of battery or any terminals.
- 4. Wear rubber gloves and boots.
- 5. Determine if the battery is inadvertently grounded. If inadvertently grounded, remove source of ground. CONTACT WITH A GROUNDED BATTERY CAN RESULT IN ELECTRICAL SHOCK! The likelihood of such shock will be reduced if such grounds are removed during installation and maintenance (applicable to a UPS and a remote battery supply not having a grounded circuit)




1. Remove the front panel on the right side.



2. Remove the two retaining screws of the cable protection cover then remove



the cable connectors.



4. Disconnect the black and red



5. Remove the three retaining screws



6. Pull out the old battery pack and replace. Reassemble the retaining screws, covers, black and red cable, and front panel in the reverse sequence of the above steps. Recharge the unit for 4-8 hours to ensure maximum UPS battery runtime.

LCD STATUS DEFINITION



information on the UPS status and current power conditions to alert you to potential power vour equipment, Note! All related UPS information is based on that you should turn INPUT voltage meter: This meter measures the AC voltage from the wall outlet. The INPUT voltage readout is used to identify the input voltage information. This can be used as a diagnostic tool to identify poor-quality input power. Units are listed in V (Volts). When the UPS connect to any equipment, the AVR can provide a stable 110/120V power output. In the event of a complete loss of power, severe brownout, or over voltage, the UPS relies on its internal battery to back up to supply a consistent 110/120V output.

OUTPUT voltage meter: The Output Voltage screen measures, in real time, the AC voltage that the UPS is providing to your connected equipment via the UPS outlets. Units are listed in V (Volts).

ESTIMATE RUN TIME: The Estimated Runtime Screen displays how many minutes of runtime can be expected of the UPS if it were to experience a power outage. When runtime becomes shorted, the battery capacity will decrease; (battery capacity bar indicator will be falling.) Note: The number displayed may be less than actual runtimes for low loads.

NORMAL icon: This icon illuminates when the UPS is working under normal conditions. BATTERY icon: When there is a severe brownout or blackout, this icon will appear followed by an alarm,

(two short beeps), indicating that the UPS is now working using its internal batteries. Once the batteries are run out of power, (over a period of time), a constant alarm will sound. If this happens and main power has not been restored, it is recommended that you save your files and turn off your equipment manually as soon as

Automatic Voltage Regulation (AVR) icon: This icon will appear when the unit is automatically regulating low or high AC input line voltage conditions, without resulting to the use of battery power

SILENT MODE icon: This icon appearing indicates that the buzzer will not be beeping while in battery operating mode. During Silent mode, the unit's alarm does not sound until the Battery Capacity falls to < 20%. OVER LOAD icon: This icon will appear followed by an alarm, indicating that an overload condition has been reached. To recover from the

 $overload\ condition,\ start\ unplugging\ your\ equipment\ from\ the\ UPS\ outlets\ until\ the\ icon\ disappears\ and\ the\ alarm\ stops.$ FAULT icon: When activated indicates a system fault error. Please refer to the troubleshooting table for possible causes and solutions. BATT. CAPACITY meter: BATT. CAPACITY is shown as a bar chart; each segment indicates approximately a 20% of battery capacity. LOAD CAPACITY: Load CAPACITY is shown as a bar chart; each segment indicates approximately a 20% of load capacity.

LCD STATUS AND SETUP FUCTIONS

1. General Mode:

a. Press the "Display-Toggle" button to check the status of the UPS.

b. Press and hold the "Display-Toggle" button for 4 seconds,

If the machine is in the Battery Mode with active alarm, it will become silent,

If the machine is in the Line Mode, a self-diagnostic test will take place. c. If the "Display-Toggle" button remains untouched for over 30 seconds, the LCD backlight will turn off automatically.

2. Set-up Mode

Step 1: Hold the "Display-Toggle" button for 10 seconds to enter the UPS Set-Up Mode.

Step 2: By pressing the Display toggle, users can switch between setup functions. Some User Configurable functions are as follows

		Item	Unit
	1	Input Voltage	V
	2	Output Voltage	٧
	3	Output Frequency	Hz
	4	Load	Kw
	5	Estimate Run Time	Min
	6	Load Capacity	%
	7	Battery Capacity	%
	8	Centigrade	$^{\circ}\!\mathbb{C}$
	9	Fahrenheit	°F

- a. Delay Time: The time delay between switching from Battery Mode to Line Mode. There are 9 different settings. The default setting is 0 minutes
- b. Battery Pack Numbers: This function provides the estimated UPS runtime using various numbers of battery packs. The default
- c. Static Frequency Tolerance: There are 6 settings (1,2,4,6,8,10 %), and the default setting is +/-6%. Functional description: The setting may be adjusted to the quality of the electricity in use.
- d. Slew rate: Also known as Dynamic Frequency Tolerance. There are 5 different settings (0.25,0.5,1,2,4 Hz/Sec). The fault value is 4Hz/sec. Functional Description: "Slew Rate" indicates the tolerance of a device in accepting frequency variance. Lower "Slew Rate" results in less tolerance but better protection for the connected load and vice versa.
- e. Low Battery Shutdown Voltage: This function will adjust the UPS shutdown point according to the battery's remaining capacity.

The settable items are sorted by unit as in the following table :

Step 3: Press and hold the display-toggle for 4 seconds. When the icons blink, the value of each item is changed by slightly pressing the toggle

Step 4: To save the value and return to general mode, press and hold the toggle for 4 seconds

Note! If the UPS is left idle for over 30 seconds during setup, it will turn off the backlight and return to general mode automatically. Note! If the user does not want to save the new settings and return to the

- general mode, there are two methods: Wait for the backlight to turn off, or,
 - 2. By pressing and holding the "Display-toggle" key for 10 second.

	Item	Unit	
1	1 Input Voltage		
2	Output Voltage	V	
3	Output Frequency	Hz	
4	Load	Kw	
5	5 Estimate Run Time		
6	Load Capacity	%	
7	Battery Capacity	%	
8	Centigrade	℃	
9	Fahrenheit	°F	
	-	_	

Items	Unit
Delay Time	Min
Battery Pack Numbers	Α
Static Frequency Tolerance	%
Slew Rate	Hz

V

Battery Shutdown Voltage

TROUBLE SHOOTIMG

Problem	Possible Cause	Solution	
	Circuit breaker has tripped due to an overload.	Turn the UPS off and unplug at least one piece of equipment Wait 10 seconds, reset the circuit breaker by depressing the button, and then turn the UPS on.	
Outlet do not provide power	Batteries are discharged	Recharge the unit for at least 4 hours	
to equipment	Unit has been damaged by a surge or spike.	Contact CyberPower Systems about replacement batteries a tech@cpsww.com	
	Uncritical outlets have turned off automatically due to an overload	Push the toggle button to make the uncritical outlets turn on.	
The UPS does not perform	Battery not fully charged.	Recharge the battery by leaving the UPS plugged in.	
expected runtime.	Battery is degraded	Contact CyberPower Systems about replacement batteries at tech@cpsww.com	
	The on/off switch is designed to prevent damage by rapidly turning it off and on.	Turn the UPS off. Wait 10 seconds and then turn the UPS on.	
The UPS will not turn on.	The unit is not connected to an AC outlet.	The unit must be connected to a 110/120v outlet.	
	The battery is worn out.	Contact CyberPower Systems about replacement batteries at tech@cpsww.com	
	Mechanical problem.	Contact CyberPower Systems at tech@cpsww.com	
	The serial cable or USB cable is not connected.	Connect the cable to the UPS unit. You must use the cable that came with the unit.	
PowerPanel® Personal	The cable is connected to the wrong port.	Try another port of your computer	
Edition is inactive	The unit is not providing battery power.	Shutdown your computer and turn the UPS off. Wait 10 seconds and turn the UPS back on. This should reset the unit.	
	The serial cable is not the cable that was provided with the unit.	You must use the cable included with the unit for the software	

Additional troubleshooting information can be found at www.cyberpowersystems.com/support.htm

TECHNICAL SPECIFICATIONS

Model	PR1000LCDRT2U	PR1500LCDRT2U	PR2200LCDRT2U	PR1000LCDRTXL2U		
Capacity(VA)	1000	1500	2170	1000		
Capacity(Watts)	700	1000	1600	700		
Input						
Input Voltage Range	80Vac-150Vac					
Input Frequency Range	50/60Hz+/-3Hz(auto sensing)					
Output						
On Battery Output Voltage	y Output Voltage Pure Sine Wave at 120Vac+/-5%					
On Battery Output Frequency		50/60 Hz +/-0.1Hz				
Transfer Time(Typical)	4 ms					
Overload Protection	On U	tility: Circuit Breaker, On E	eaker, On Battery: Internal Current Limiting			
Surge Protection and Filtering						
Lightning/Surge Protection	Yes					
Internet Ready(DSL/Phone/	RJ11/RJ45(One In/One Out)					
-AX/Modem Protection)						
Physical Output Receptacles		8		6		
Dimensions(in)	8 2U Rack, 17.1" x 15.3"x 3.5"					
Weight (lb)	58	60	66	66		
Battery		55	00	- 55		
Sealed Maintenance Free Lead				12V / 7.0AHx4		
Acid Battery	12V / 7.	0AHx4	12V / 9.0AHx4	Extended runtime		
Hot Swappable External Battery	Yes					
Warning Diagnostics						
Indicators	Power On, Wiring Fault,	LCD Display (Using Batte	ry, AVR, Load Level, Batte	ery Level)		
Audible Alarms		On Battery, Low	Battery, Overload			
Environmental						
Operating Temperature		32°Fto 104°F	F(0°C to40°C)			
Operating Relative Humidity						
Communication						
PowerPanel [®] Business Edition	Windows 98/ME/NT/2000/XP, Vista, Windows 7					
Management						
Self-Test	Manual Self-Test					
Auto-Charger/ Auto-Restart	estart Yes					
COM Interface	True RS232 x1+ Dry connector x1					
Built-in USB Interface	B Interface Yes					
SNMP/ HTTP Network Slot	Network Slot Yes					
Safety Approvals		UL1778,cUL107,				

CYBERPOWER GREENPOWER UPS™ TECHNOLOGY

GreenPower UPS™

The CyberPower GreenPower UPS™ cuts UPS energy costs by up to 75% compared to the conventional UPS circuits. Conventional UPS systems pass power through a transformer to provide normal output voltage to protected devices. By contrast, the GreenPower UPS™ circuitry bypasses the transformer when utility power is normal, significantly increasing the power efficiency of the UPS. As a result, a GreenPower UPS™ produces less heat and uses less energy reducing energy costs.



When utility power is abnormal, the GreenPower UPS™ operates like a normal UPS. Since utility power operates normally 88% of the time, the GreenPower UPS™ operates primarily in its cost-cutting bypass mode

LIMITED WARRANTY AND CONNECTED EQUIPMENT GUARNTEE

PR1000LCDRT2U/PR1000LCDRTXL2U/PR1500LCDRT2U/PR2200LCDRT2U (the "Product"). By using the Product you consent to be bound by and become a party to the terms and conditions of this Limited Warranty and Connected Equipment Guarantee (together referred to as this "Warranty"). If you do not agree to the terms and conditions of this Warranty, you should return the Product for a full refund prior to using it.

Who is Providing this Warranty?

CyberPower Systems (USA), Inc. ("CyberPower") provides this Limited Warranty.

What Does This Warranty Cover?

This warranty covers defects in materials and workmanship in the Product under normal use and conditions. It also covers equipment that was connected to the Product and damaged because of the failure of the Product.

What is the Period of Coverage?

This warranty covers the Product for three years and connected equipment for as long as you own the Product.

Who Is Covered?

This warranty only covers the original purchaser. Coverage ends if you sell or otherwise transfer the Product.

- 1. Call us at (877) 297-6937 or write to us at Cyber Power Systems (USA), Inc., 4241 12th Ave. E., STE 400, Shakopee, MN 55379 or send us an e-mail message at claims@cpsww.com for instructions
- 2. When you contact CyberPower, identify the Product, the Purchase Date, and the item(s) of Connected Equipment. Have information on all applicable insurance or other resources of recovery/payment that are available to the Initial Customer and Request a Claim Number.
- 3. You must provide a dated Proof-of-Purchase receipt (or other proof of the original purchase) and provide a description of the defect
- 4. Pack and ship the product with a dated Proof- of-Purchase receipt to CyberPower and, if requested, the item(s) of Connected Equipment, a repair cost estimate for the damage to the Connected Equipment, and all claim forms that CyberPower provides to you. Show the Claim Number on the shipping label or include it with the product. You must prepay all shipping costs, you are responsible for packaging and shipment, and you must pay the cost of the repair estimate

How Long Do I Have To Make A Claim?

All claims must be made within ten days of the occurrence

What Will We Do To Correct Problems?

CyberPower will inspect and examine the Product.

If the Product is defective in material or workmanship, CyberPower will repair or replace it at CyberPower's expense, or, if CyberPower is unable to or decides not to repair or replace the Product (if defective) within a reasonable time, CyberPower will refund to you the full purchase price you paid for the Product (purchase receipt showing price paid is required).

If it appears that our Product failed to protect any equipment plugged into it, we will also send you forms for making your claim for the connected equipment. We will repair or replace the equipment that was damaged because of the failure of our Product or pay you the fair market value (NOT REPLACEMENT COST) of the equipment at of the time of the damage. We will use Orion Blue Book, or another a third-party valuation guide, or eBay, craigslist, or other source to establish that amount. Our maximum liability is limited to \$400,000 for PR1000LCDRT2U/PR1000LCDRTXL2U/PR1500LCDRT2U/PR2200LCDRT2U.

Who Pays For Shipping?

We pay when we send items to you; you pay when you send items to us

What Are Some Things This Warranty Does Not Cover?

- 1. This Warranty does not cover any software that was damaged or needs to be replaced due to the failure of the Product or any data that is lost as a result of the failure or the restoration of data or records, or the reinstallation of software.
- 2. This Warranty does not cover or apply to: misuse, modification, operation or storage outside environmental limits of the Product or the equipment connected to it, nor for damage while in transit or in storage, nor if there has been improper operation or maintenance, or use with items not designed or intended for use with the Product, such as laser printers, appliances, aquariums, medical or life support devices, etc.

What Other Limitations Apply?

- 1. This Warranty does not apply unless the Product and the equipment that was connected to it were connected to properly wired and grounded outlets (including compliance with electrical and safety codes of the most current electrical code), without the use of any adapters or other
- 2. The Product must have been plugged directly into the power source and the equipment connected to the Product must be directly connected to the Product and not "daisy-chained" together in serial fashion with any extension cords, another Product or device similar to the Product, surge suppressor, or power tap. Any such installation voids the Limited Warranty.
- 3. The Product and equipment connected to it must have been used properly in a suitable and proper environment and in conformance with any
- license, instruction manual, or warnings provided with the Product and the equipment connected to it. 4. The Product must have been used at all times within the limitations on the Product's VA capacity.

What are the Limitations?

The sole and exclusive remedies of the Initial Customer are those provided by this Warranty.

The Product was designed to eliminate disrupting and damaging effects of momentary (less than 1ms) voltage spikes or impulses from lightning or other power transients. If it can be shown that a voltage spike lasting longer than 1ms has occurred, the occurrence will be deemed outside the rated capabilities of the Product and the Limited Warranty is void. CyberPower Does Not Cover or Undertake Any Liability in Any Event for Any of the Following:

- 1. Loss of or damage to data, records, or software or the restoration of data or records, or the reinstallation of software
- 2. Damage from causes other than AC Power Line Transients, spikes, or surges on properly installed, grounded and code-compliant 120 volt power lines in the United States and Canada; transients, surges or spikes on standard telephone land lines, PBX telephone equipment lines or Base 10T Ethernet lines, when properly installed and connected. (This exclusion applies, for example, to fluctuations in data transmission or reception, by CATV or RF transmission or fluctuations, or by transients in such transmission.)
- 3. Damage from any circumstance described as excluded above with respect to the Product.
- 4. Damages from fire, flood, wind, rain, rising water, leakage or breakage of plumbing, abuse, misuse or alteration of either the product or the Connected Equipment
- 5. CyberPower excludes any liability for personal injury under the Limited Warranty and Connected Equipment Guarantee. CyberPower excludes any liability for direct, indirect, special, incidental or consequential damages, whether for damage to or loss of property [EXCEPT FOR (AND ONLY FOR) the specific limited agreement of CyberPower to provide certain warranty benefits regarding "Connected Equipment" under this Warranty], loss of profits, business interruption, or loss of information or data. NOTE: Some States or Provinces do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation may not apply to you.
- 6. The Product is not for use in high-risk activities or with aquariums. The Product is not designed or intended for use in hazardous environments requiring fail-safe performance, or for use in any circumstance in which the failure of the Product could lead directly to death, personal injury, or severe physical or property damage, or that would affect operation or safety of any medical or life support device (collectively, "High Risk Activities"). CyberPower expressly disclaims any express or implied warranty of fitness for High Risk Activities or with aquariums. CyberPower does not authorize use of any Product in any High Risk Activities or with Aquariums, ANY SUCH USE IS IMPROPER AND IS A MISUSE OF THE

The application of the United Nations Convention of Contracts for the International Sale of Goods is expressly excluded. CyberPower is the warrantor under this Limited Warranty.

For further information please feel free to contact CyberPower at Cyber Power Systems (USA), Inc. 4241 12th Ave E., STE 400, Shakopee, MN 55379; call us at (877) 297-6937; or send us an e-mail message at claims@cpsww.com.



This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1)This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

WARNING!! This equipment has been tested and found to comply with the limits for a Class B Digital Device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures: (1) Reorient or relocate the receiving antenna. (2) Increase the separation between the equipment and receiver. (3) Connect the equipment into an outlet on a circuit different from that to which the receiver is connected. (4) Consult the dealer or an experienced radio/TV technician for help. Any special accessories needed for compliance must be specified in the instruction.

The Class B digital apparatus meets all requirements of the Canadian Interference-Causing Equipment Regulation.

Cet appareil numerique de la class B respecte toutes les exigencies du Reglement sur le materiel brouilleur du Canada